




EARTHLINKED
TECHNOLOGIES

EarthLinked®
SW Series Compressor Unit
Quik-Start Electrical Supplement
for
50 Hertz Power
and
R-407C Refrigerant



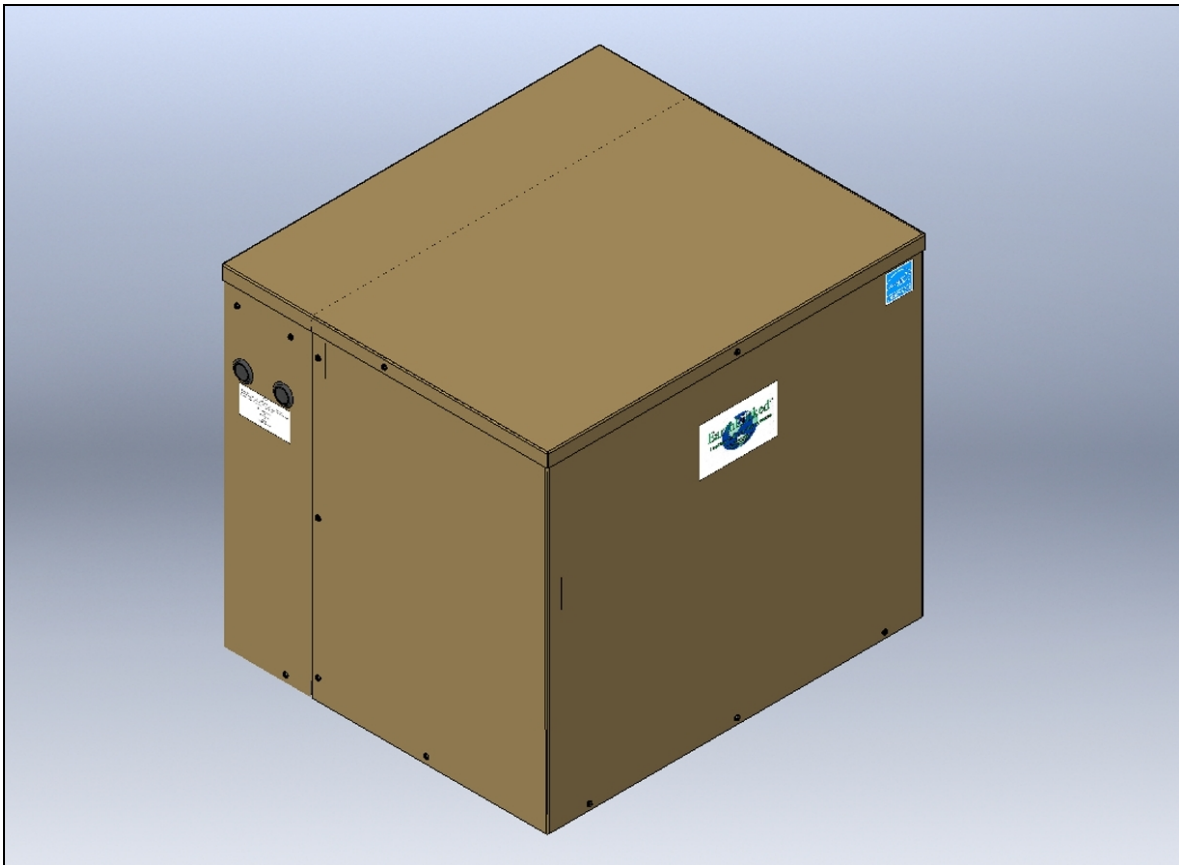

IMPORTANT!

The information contained in this manual supplements the Compressor Unit Quik-Start Manual. It contains compressor model number nomenclature, electrical data and electrical ladder and schematic illustrations for 50 Hertz power supply and R-410A or R-407C refrigerant systems.

Disclaimer

Proper installation and servicing of the EarthLinked® Heating and Cooling System is essential to its reliable performance. All EarthLinked® systems must be installed and serviced by an ETI authorized, trained technician. Installation and service must be made in accordance with the instructions set forth in this manual. Failure to provide installation and service by an authorized, trained installer in a manner consistent with the subject manuals will void and nullify the limited warranty coverage for the system.

Earthlinked Technologies shall not be liable for any defect, unsatisfactory performance, damage or loss, whether direct or consequential, relative to the design, manufacture, construction, application or installation of the field specified components.



**ETL LISTED
CONFORMS TO
UL STD 1995
US CERTIFIED TO CAN/CSA
STD C22.2 NO. 236-05**



**COMPLIES WITH
IEC 60204-1
IEC 60335-2-40
IEC 61000-3-11**

Earthlinked Technologies, Inc.


4151 South Pipkin Road

Lakeland, Florida 33811

tel. 863-701-0096 • fax 863-701-7796

info@earthlinked.com • www.earthlinked.com

Compressor Unit Model Numbers

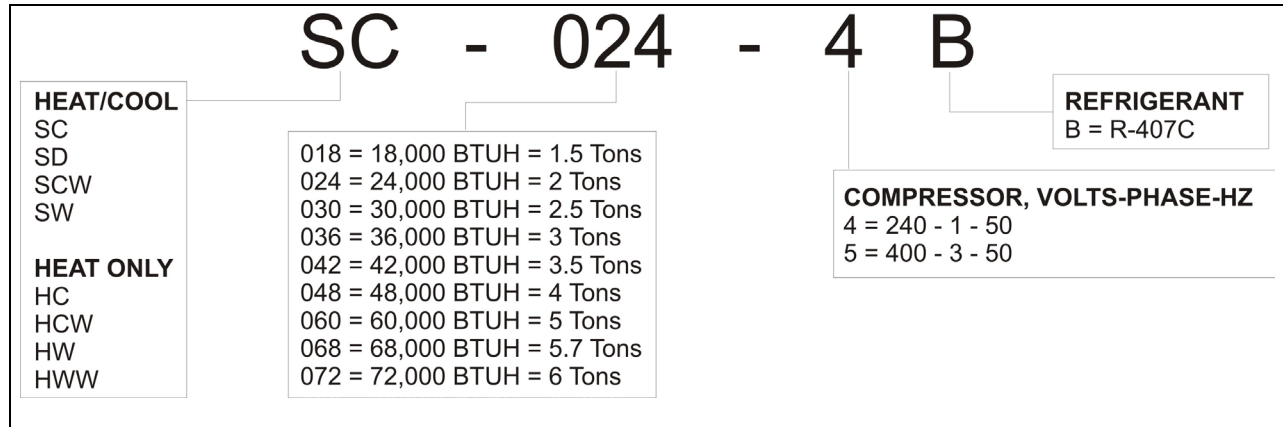

Electrical Data – R-407C

Compressor Unit Model	Compressor Model	Voltage/Phase/Hz	Voltage		LRA	RLA	MCA	MFS
			Min.	Max.				
-018-4B	ZR25K5E-PFJ	240-1-50	216	264	61	10.9	13	20
-024-4B	ZR32K5E-PFJ	240-1-50	216	264	79	12.8	16	30
-024-5B	ZR32K5E-TFD	400-3-50	360	440	38	5.8	7	10
-030-4B	ZR38K5E-PFJ	240-1-50	216	264	87	15.4	19	30
-030-5B	ZR38K5E-TFD	400-3-50	360	440	47	5.8	7	10
-036-4B	ZR48K5E-PFJ	240-1-50	216	264	133	19.2	24	35
-036-5B	ZR48K5E-TFD	400-3-50	360	440	60	7.1	9	10
-048-4B	ZR61KCE-PFZ	240-1-50	216	264	150	25.6	31	45
-048-5B	ZR61KCE-TFD	400-3-50	360	440	66	9.0	11	15
-060-4B	ZR72KCE-TFD	400-3-50	360	440	74	9.0	11	15
-072-5B	ZR81KCE-TFD	400-3-50	360	440	101	10.9	13	20
LRA = Locked Rotor Amps RLA = Rated Load Amps MCA = Minimum Circuit Ampacity MFS = Maximum Fuse or HACR Circuit Breaker Size (External) AWG = Consult NEC and Local Codes								



IMPORTANT


R-407C EARTHLINKED® SYSTEMS THAT PROVIDE SPACE COOLING SHALL BE EQUIPPED WITH AN EARTHLINKED® AUXILIARY COOLING MODULE (ACM) WHEN BOTH OF THE FOLLOWING CIRCUMSTANCES OCCUR:

- **AMIBENT OUTDOOR TEMPERATURES HAVE EXCEEDED THE OUTDOOR SUMMER DESIGN TEMPERATURE CONDITIONS FOR AT LEAST 7 HOURS OF CONTINUOUS SYSTEM RUN TIME, COUPLED WITH THE FOLLOWING CONDITIONS:**
- **LOW THERMAL CONDUCTIVITY SOILS THAT DO NOT EFFECTIVELY ABSORB AND DISSIPATE HEAT. EXAMPLES OF SUCH SOILS ARE LIGHT DRY SOIL, DRY SAND, PEAT AND ORGANIC SOILS, DRY CLAY SOILS AND HARDPAN.**

R-407C EARTHLINKED® SYSTEMS THAT PROVIDE HEATING REQUIRE A HEATING PERFORMANCE ENHANCEMENT KIT (HPE-1872) WHEN (1) IN COMMERCIAL COOLING LOAD APPLICATIONS OR (2) WHERE LOCAL EARTH TEMPERATURE IS 70°F OR ABOVE.


SW Compressor Unit

240-1-50 Ladder

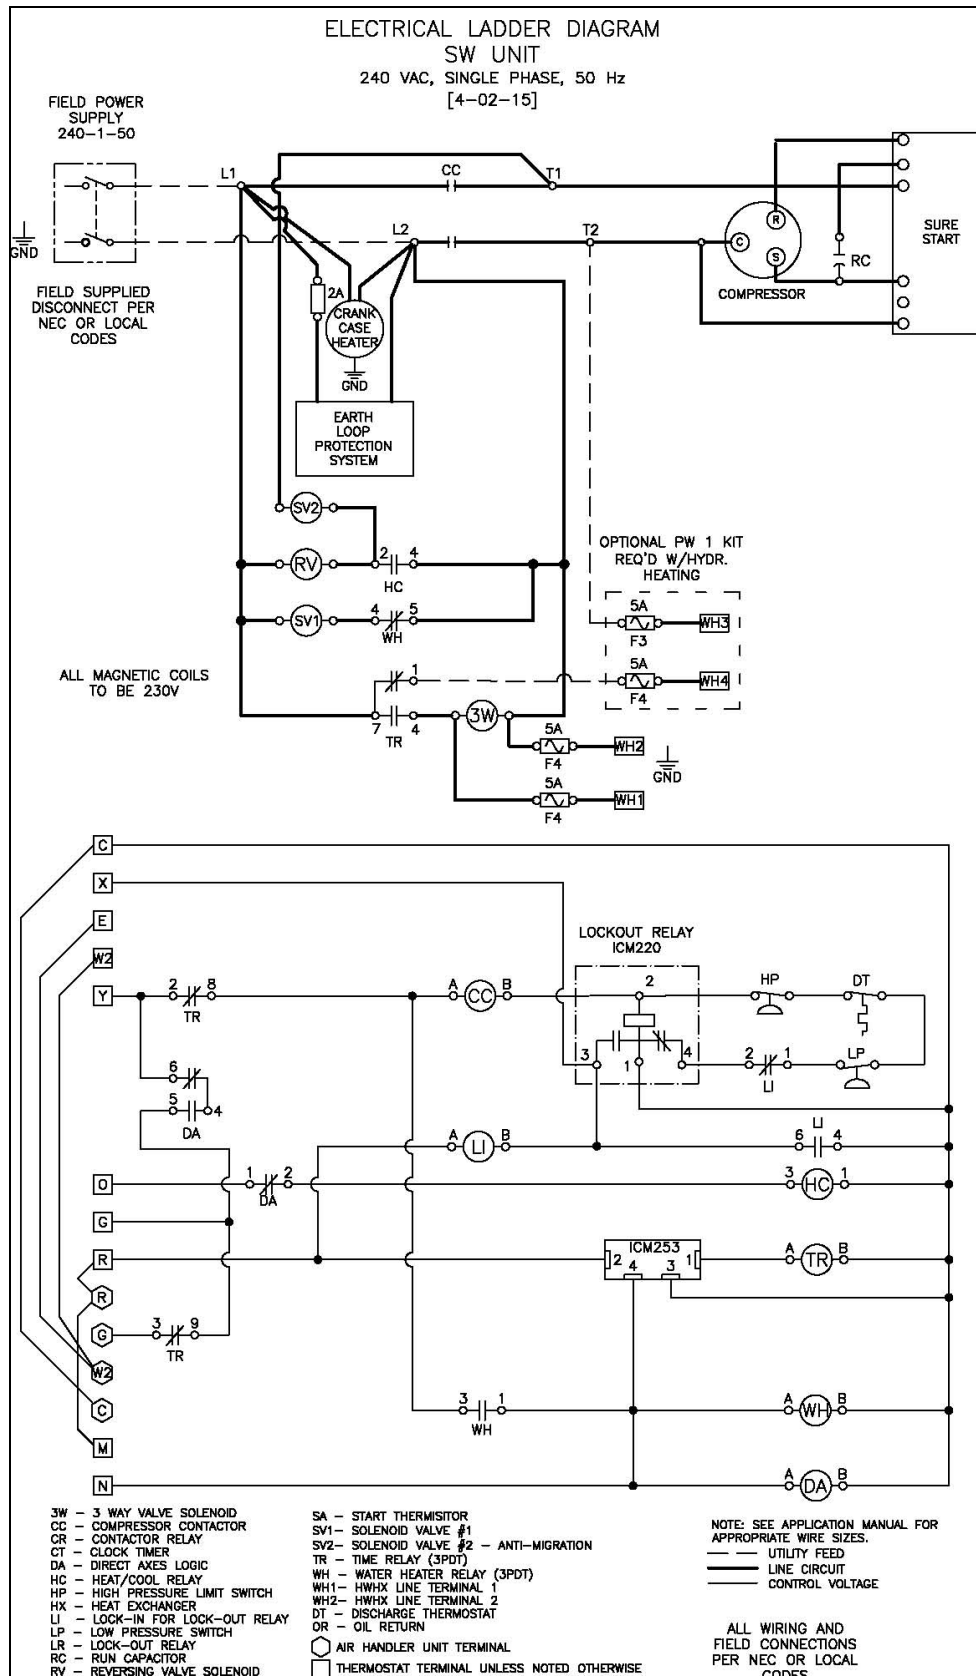


SW Compressor Unit

240-1-50 Schematic

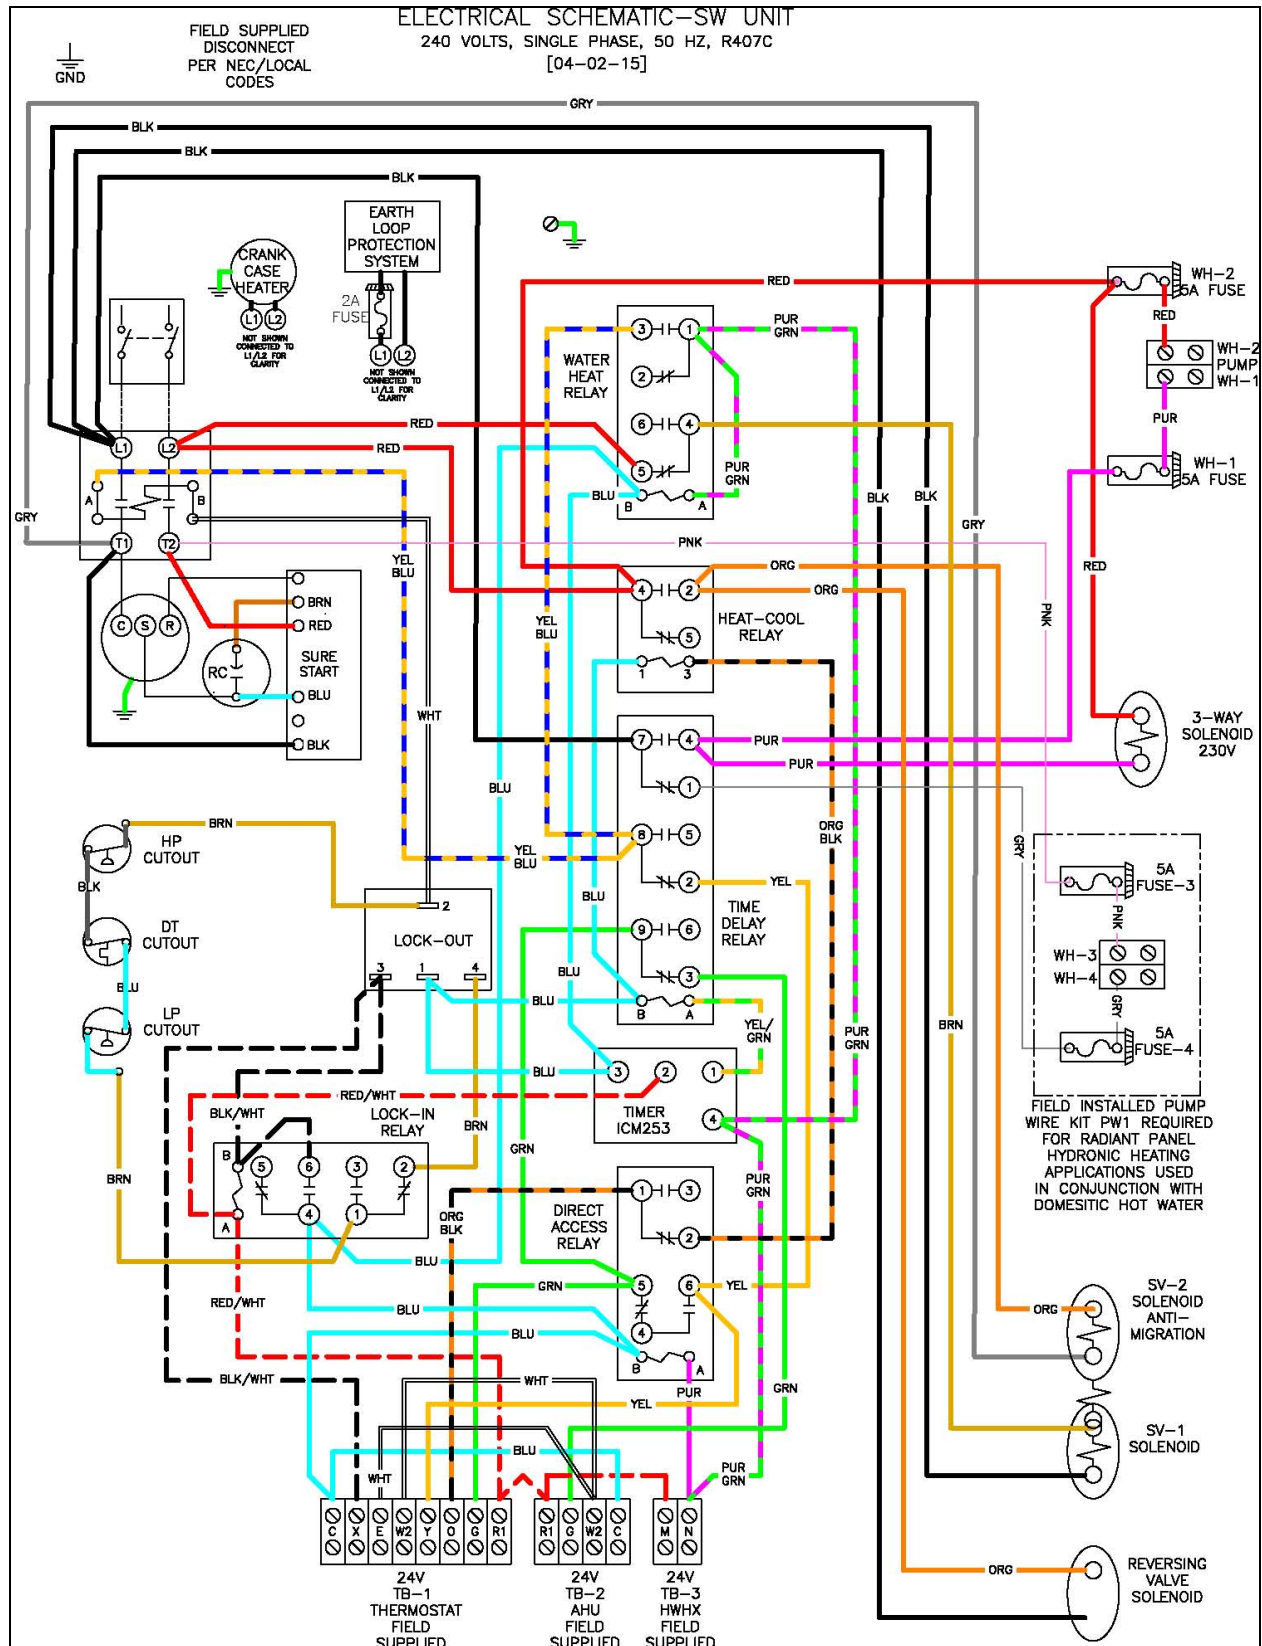

SW Compressor Unit

400-3-50 Ladder

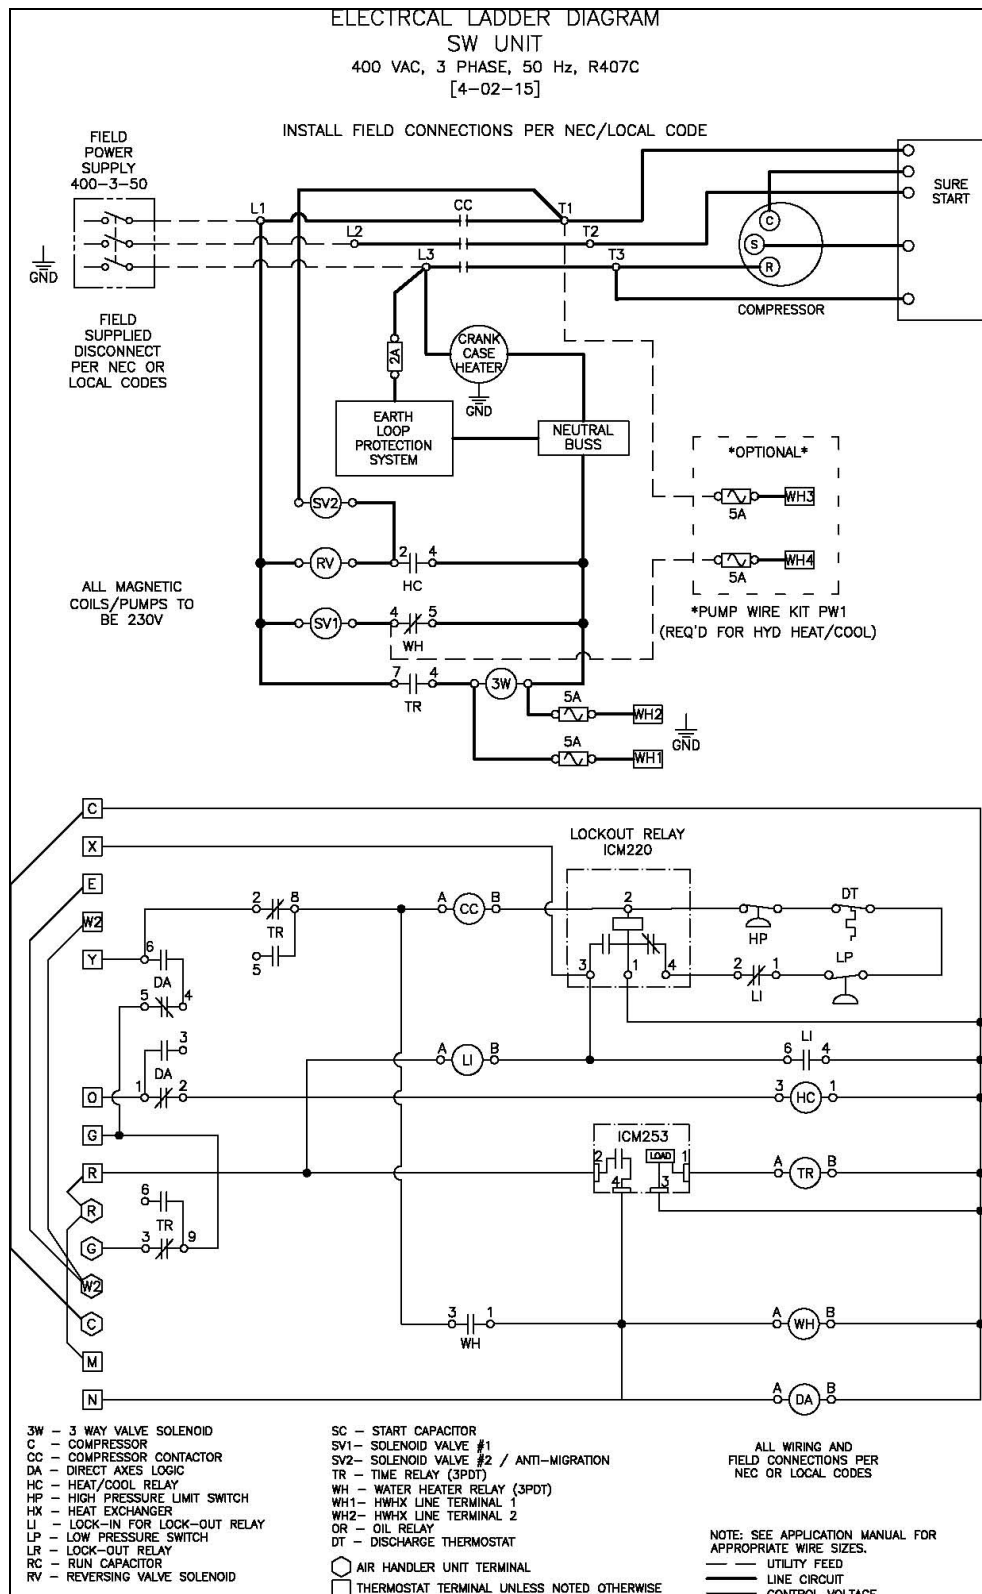

400-3-50 Schematic

